
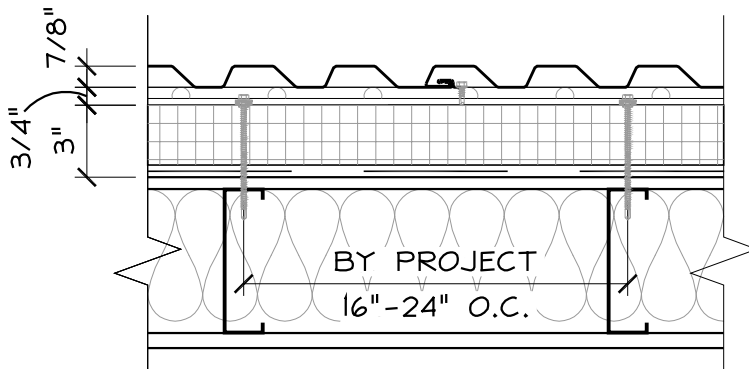


CODE = R-13 + R-10ci | U-0.055

BASE = R-19ci | U-0.050*

OPTIMIZED = R-19ci + R-19 | U-0.036*

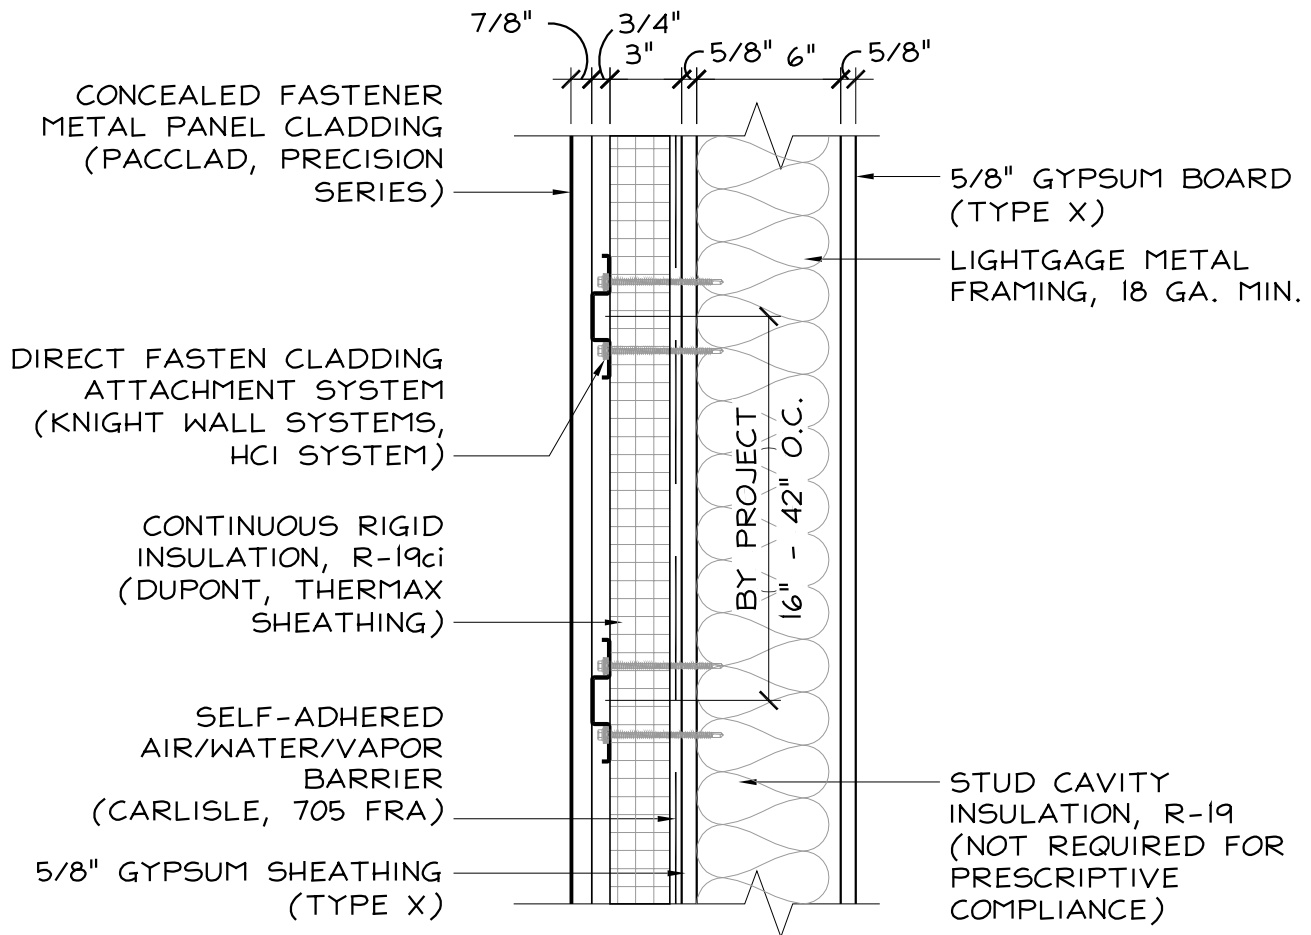

NOTE:
METAL PANEL DEPTH
MAY VARY DEPENDING
ON PRECISION SERIES
PANEL SPECIFIED


METAL PANEL CLADDING w/ METAL STUD

SCALE: 1 1/2" = 1'-0"



Dewpoint Analysis - Dow Chemical

PACE BOD_Cladding w/ Rigid Insulation_R-19ci

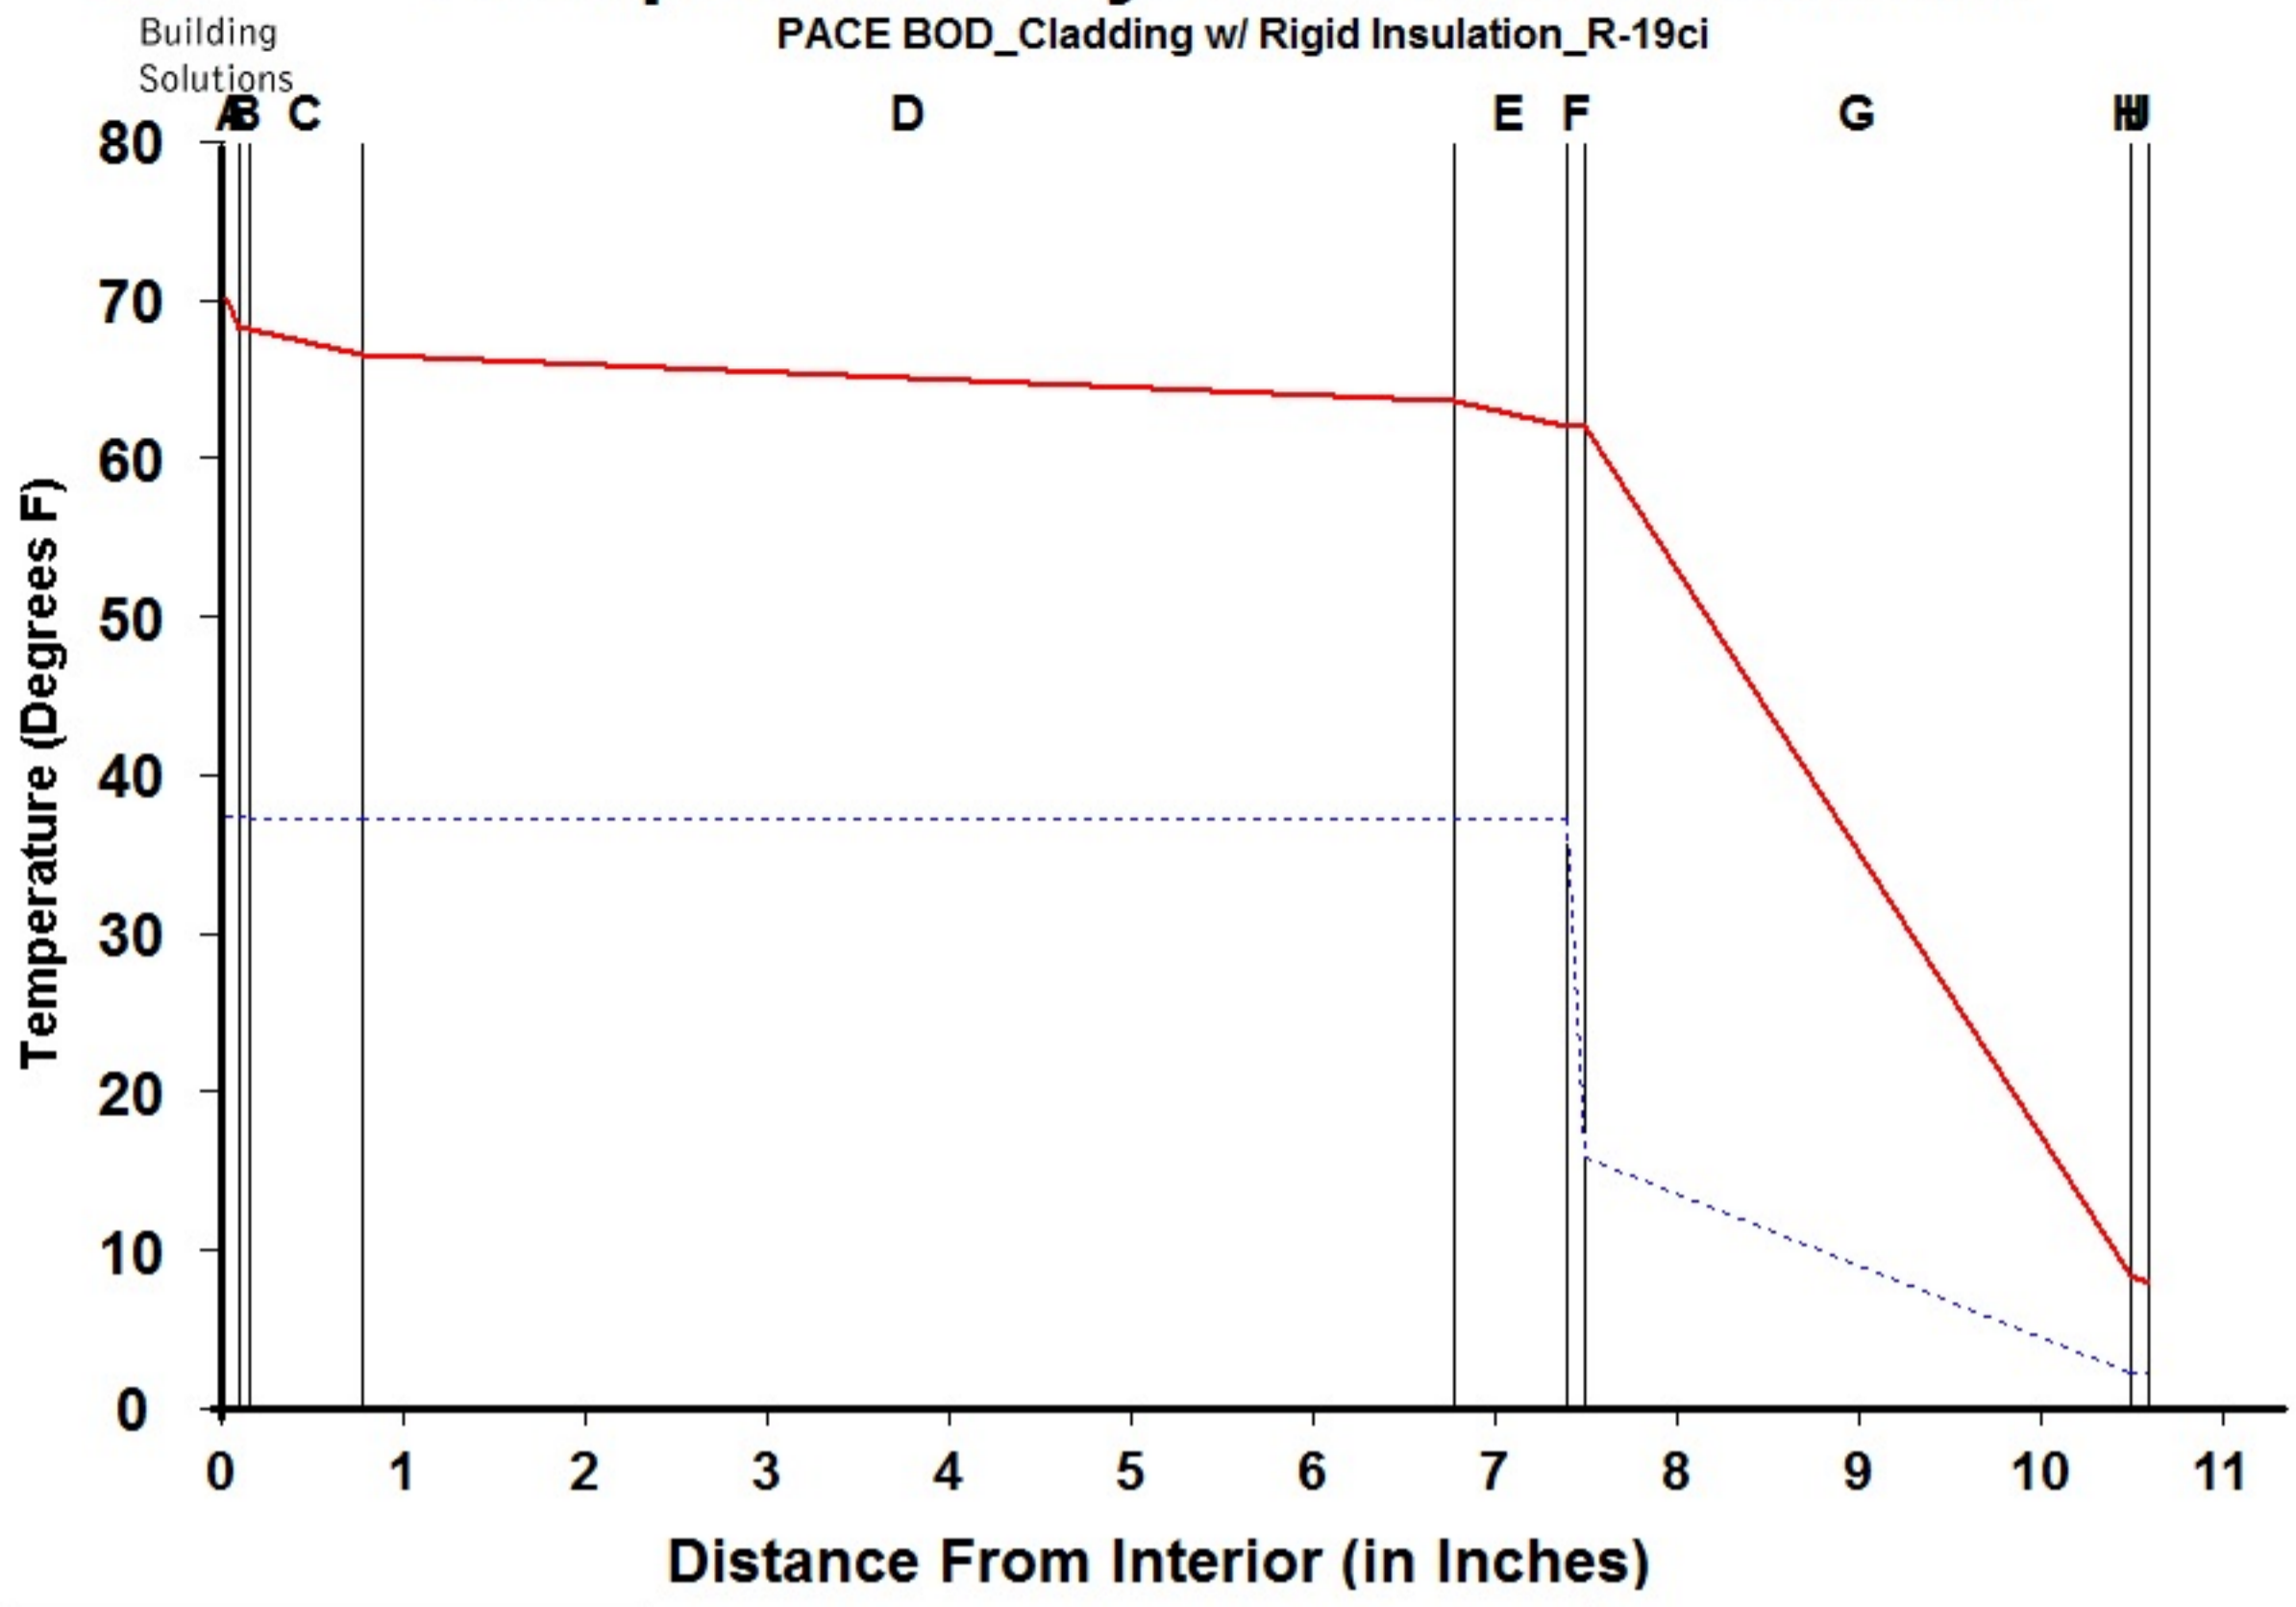

Legend	
—	Actual Temperature
- - - -	Dewpoint Temperature

Dewpoint Theory predicts condensation in a system at any point where the actual and dewpoint temperature lines cross.

Conditions:		
	Interior	Exterior
Temperature	70.0	7.7
Humidity	30.0	75.0


Component Name	Thickness	R-Value	Rep
A Interior Air Film	0.100	0.68	0.001
B Latex Paint 2 Coat	0.050	0.01	0.500
C Gypsum Board	0.625	0.56	0.023
D Wall Air Space NonRefl	6.000	1.05	0.006
E Gypsum Sheathing	0.625	0.56	0.027
F CCW 705FRA	0.100	0.01	100.000
G DuPont Thermax Sheathing	3.000	19.00	30.000
H Wall Air Space NonRefl	0.000	0.00	0.000
I Ventilated Cladding	0.000	0.00	0.000
J Out Air Film Winter	0.100	0.17	0.001
K			
L			
TOTAL	10.600	22.04	130.558

Interface	Temperature Actual	Temperature Dewpnt	Accum (oz/day-sqft)
-A	70.00	37.17	0.000
AB	68.08	37.17	0.000
BC	68.05	37.09	0.000
CD	66.47	37.08	0.000
DE	63.50	37.08	0.000
EF	61.92	37.08	0.000
FG	61.89	15.67	0.000
GH	8.18	2.08	0.000
HI	8.18	2.08	0.000
IJ	8.18	2.08	0.000
JK	7.70	2.08	0.000
KL			
L-			



Dewpoint Analysis - Dow Chemical

PACE BOD_Cladding w/ Rigid Insulation_R-19ci + R-19

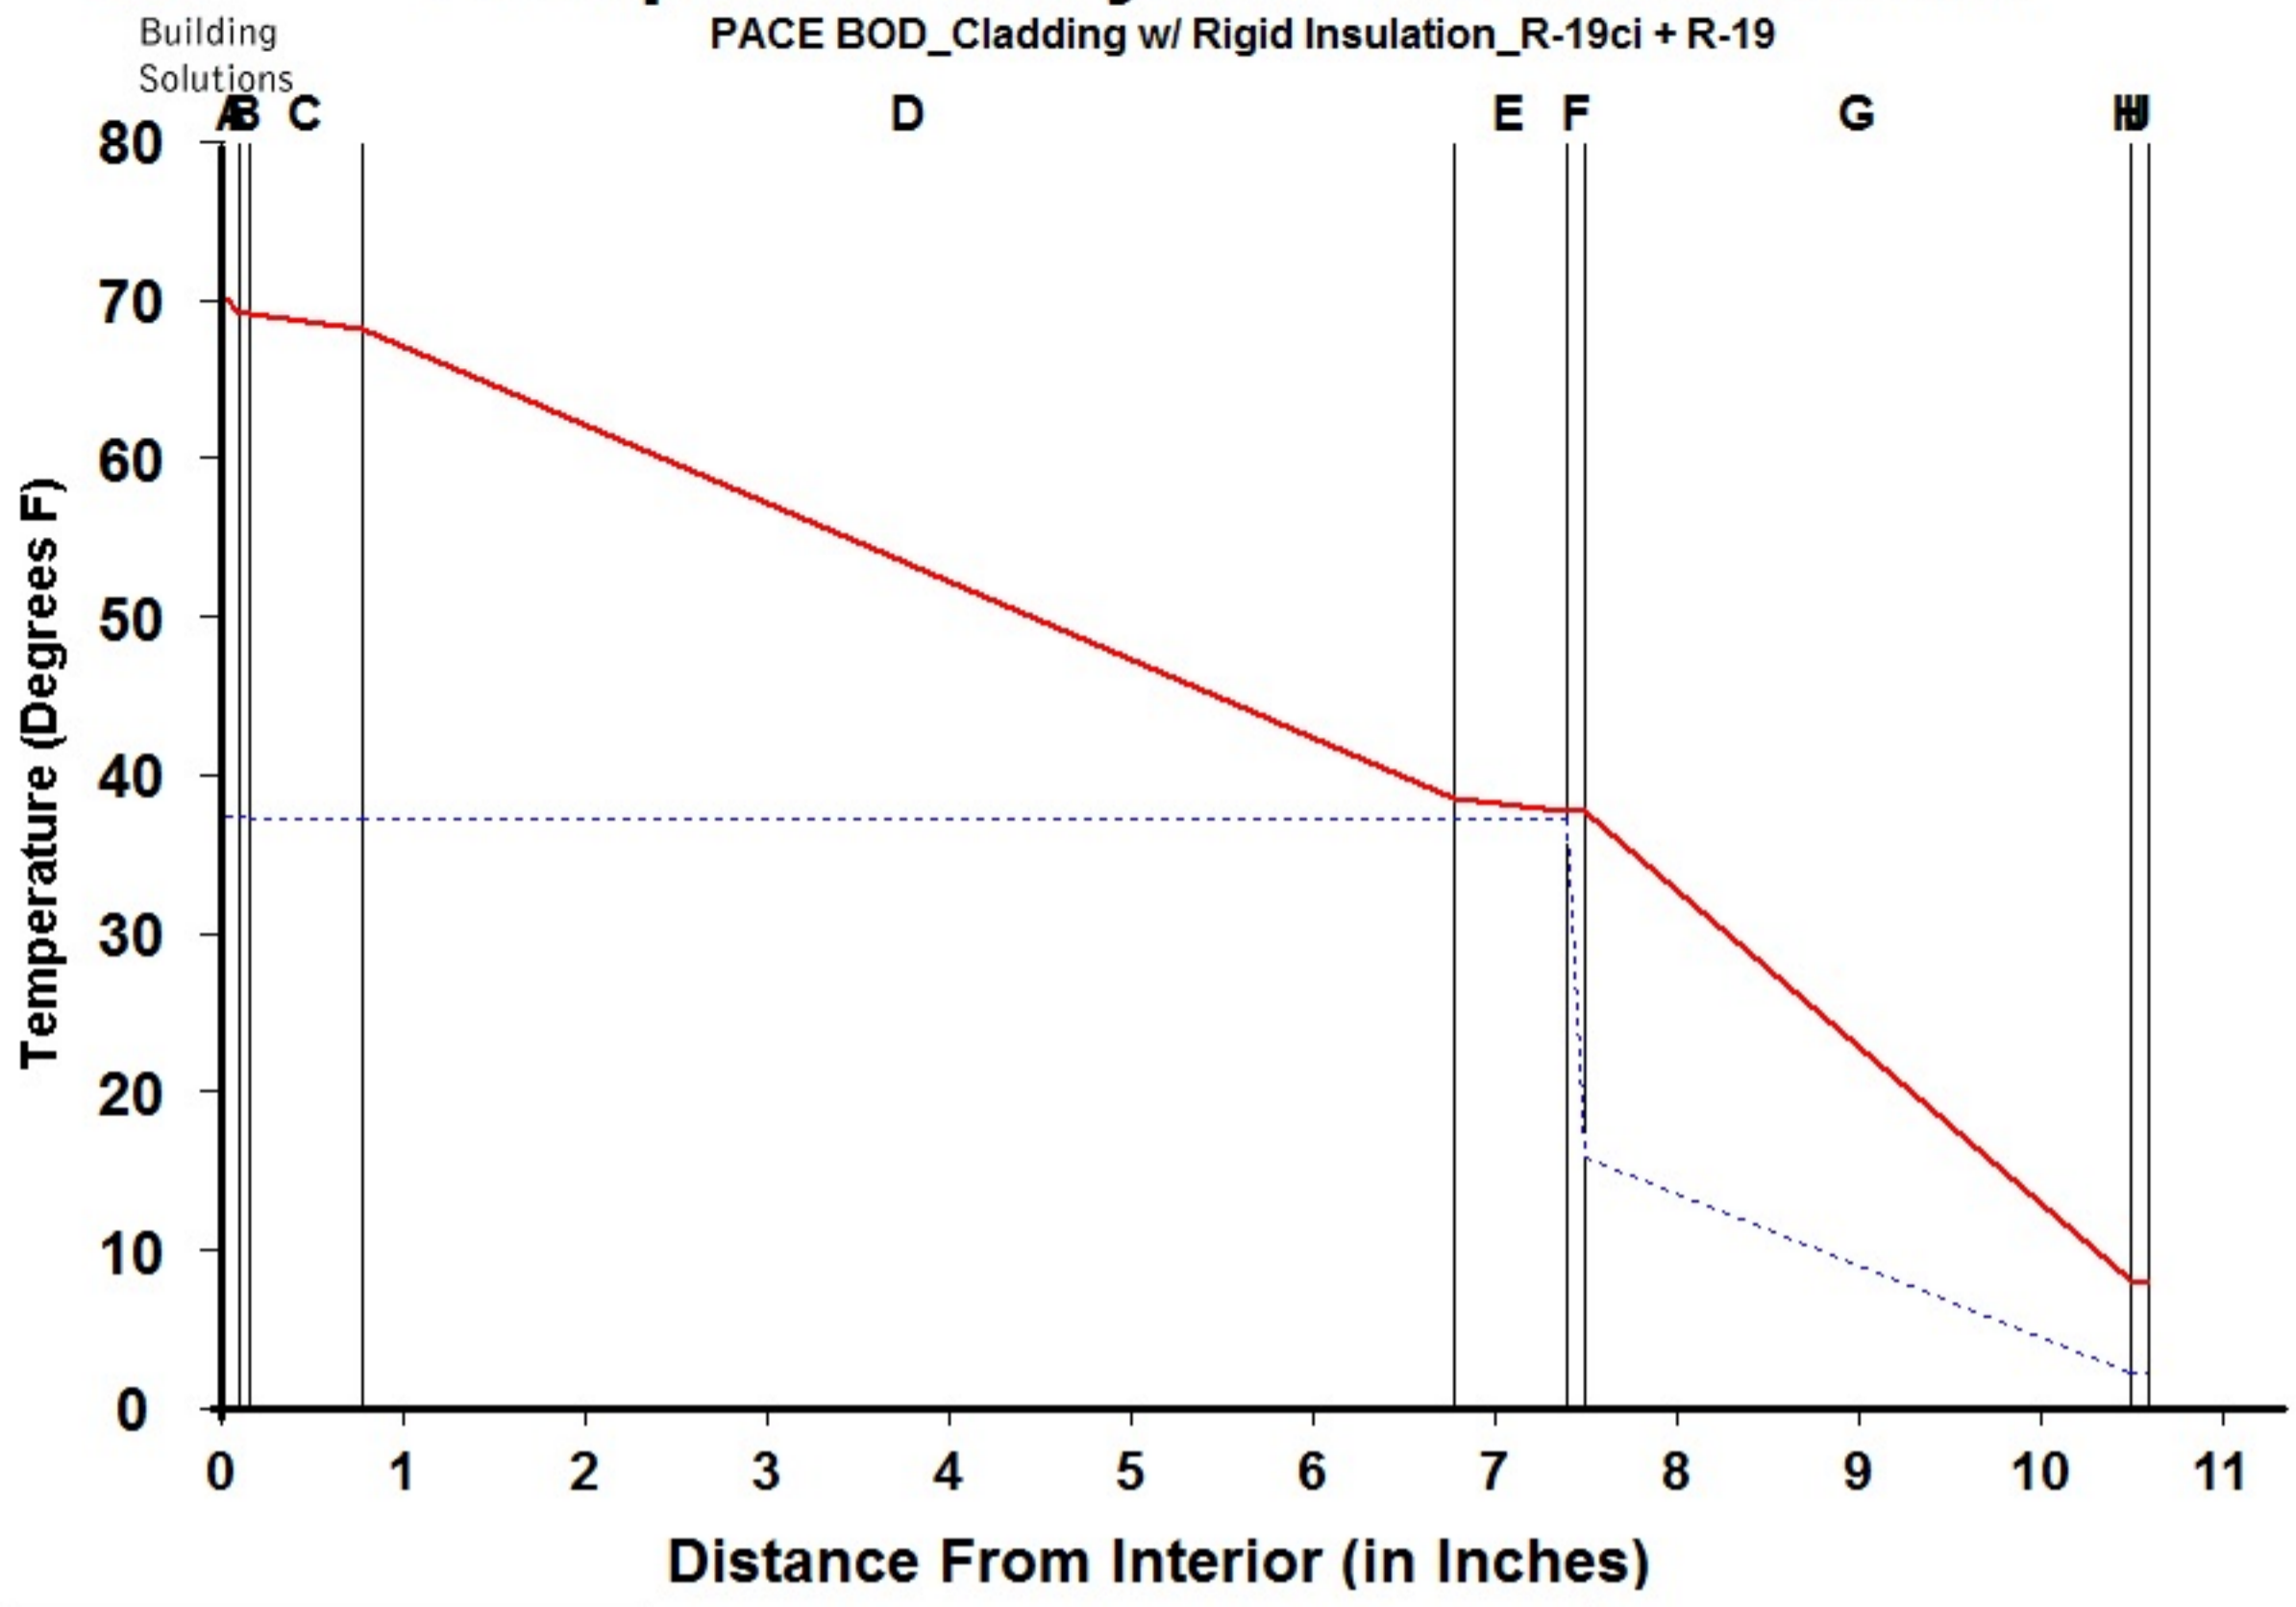

Legend	
—	Actual Temperature
- - -	Dewpoint Temperature

Dewpoint Theory predicts condensation in a system at any point where the actual and dewpoint temperature lines cross.

Conditions:		
	Interior	Exterior
Temperature	70.0	7.7
Humidity	30.0	75.0

Component Name	Thickness	R-Value	Rep
A Interior Air Film	0.100	0.68	0.001
B Latex Paint 2 Coat	0.050	0.01	0.500
C Gypsum Board	0.625	0.56	0.023
D Batt Insulation	6.000	19.00	0.010
E Gypsum Sheathing	0.625	0.56	0.027
F CCW 705FRA	0.100	0.01	100.000
G DuPont Thermax Sheathing	3.000	19.00	30.000
H Wall Air Space NonRefl	0.000	0.00	0.000
I Ventilated Cladding	0.000	0.00	0.000
J Out Air Film Winter	0.100	0.17	0.001
K			
L			
TOTAL	10.600	39.99	130.562

Interface	Temperature		Accum (oz/day-sqft)
	Actual	Dewpnt	
-A	70.00	37.17	0.000
AB	68.94	37.17	0.000
BC	68.93	37.09	0.000
CD	68.05	37.08	0.000
DE	38.45	37.08	0.000
EF	37.58	37.08	0.000
FG	37.56	15.67	0.000
GH	7.96	2.08	0.000
HI	7.96	2.08	0.000
IJ	7.96	2.08	0.000
JK	7.70	2.08	0.000
KL			
L-			