
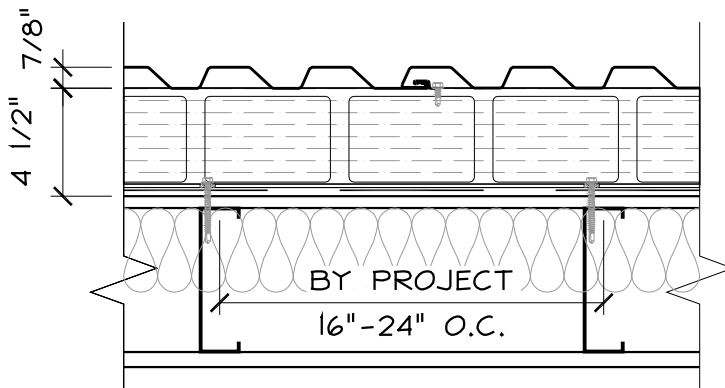


CODE = R-13 + R-10ci | U-0.055

BASE = R-19.4ci | U-0.053*

OPTIMIZED = R-19.4ci + R-13 | U-0.040*

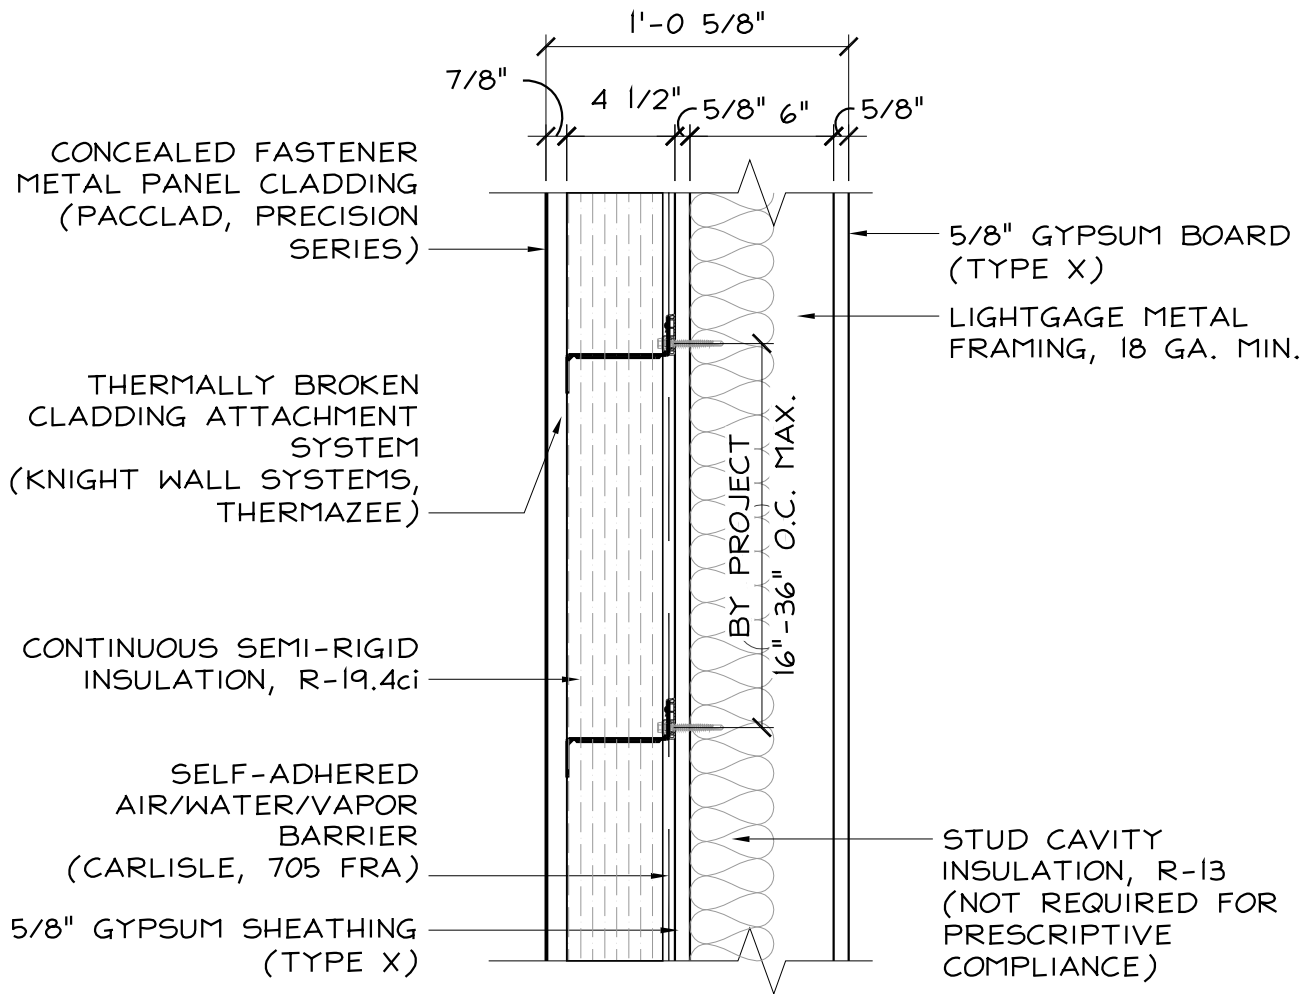

NOTE:
METAL PANEL DEPTH
MAY VARY DEPENDING
ON PRECISION SERIES
PANEL SPECIFIED


METAL PANEL CLADDING w/ METAL STUD

SCALE: 1 1/2" = 1'-0"



Dewpoint Analysis - Dow Chemical

PACE BOD_Cladding w/ Semi-Rigid Insulation_R-19.4ci

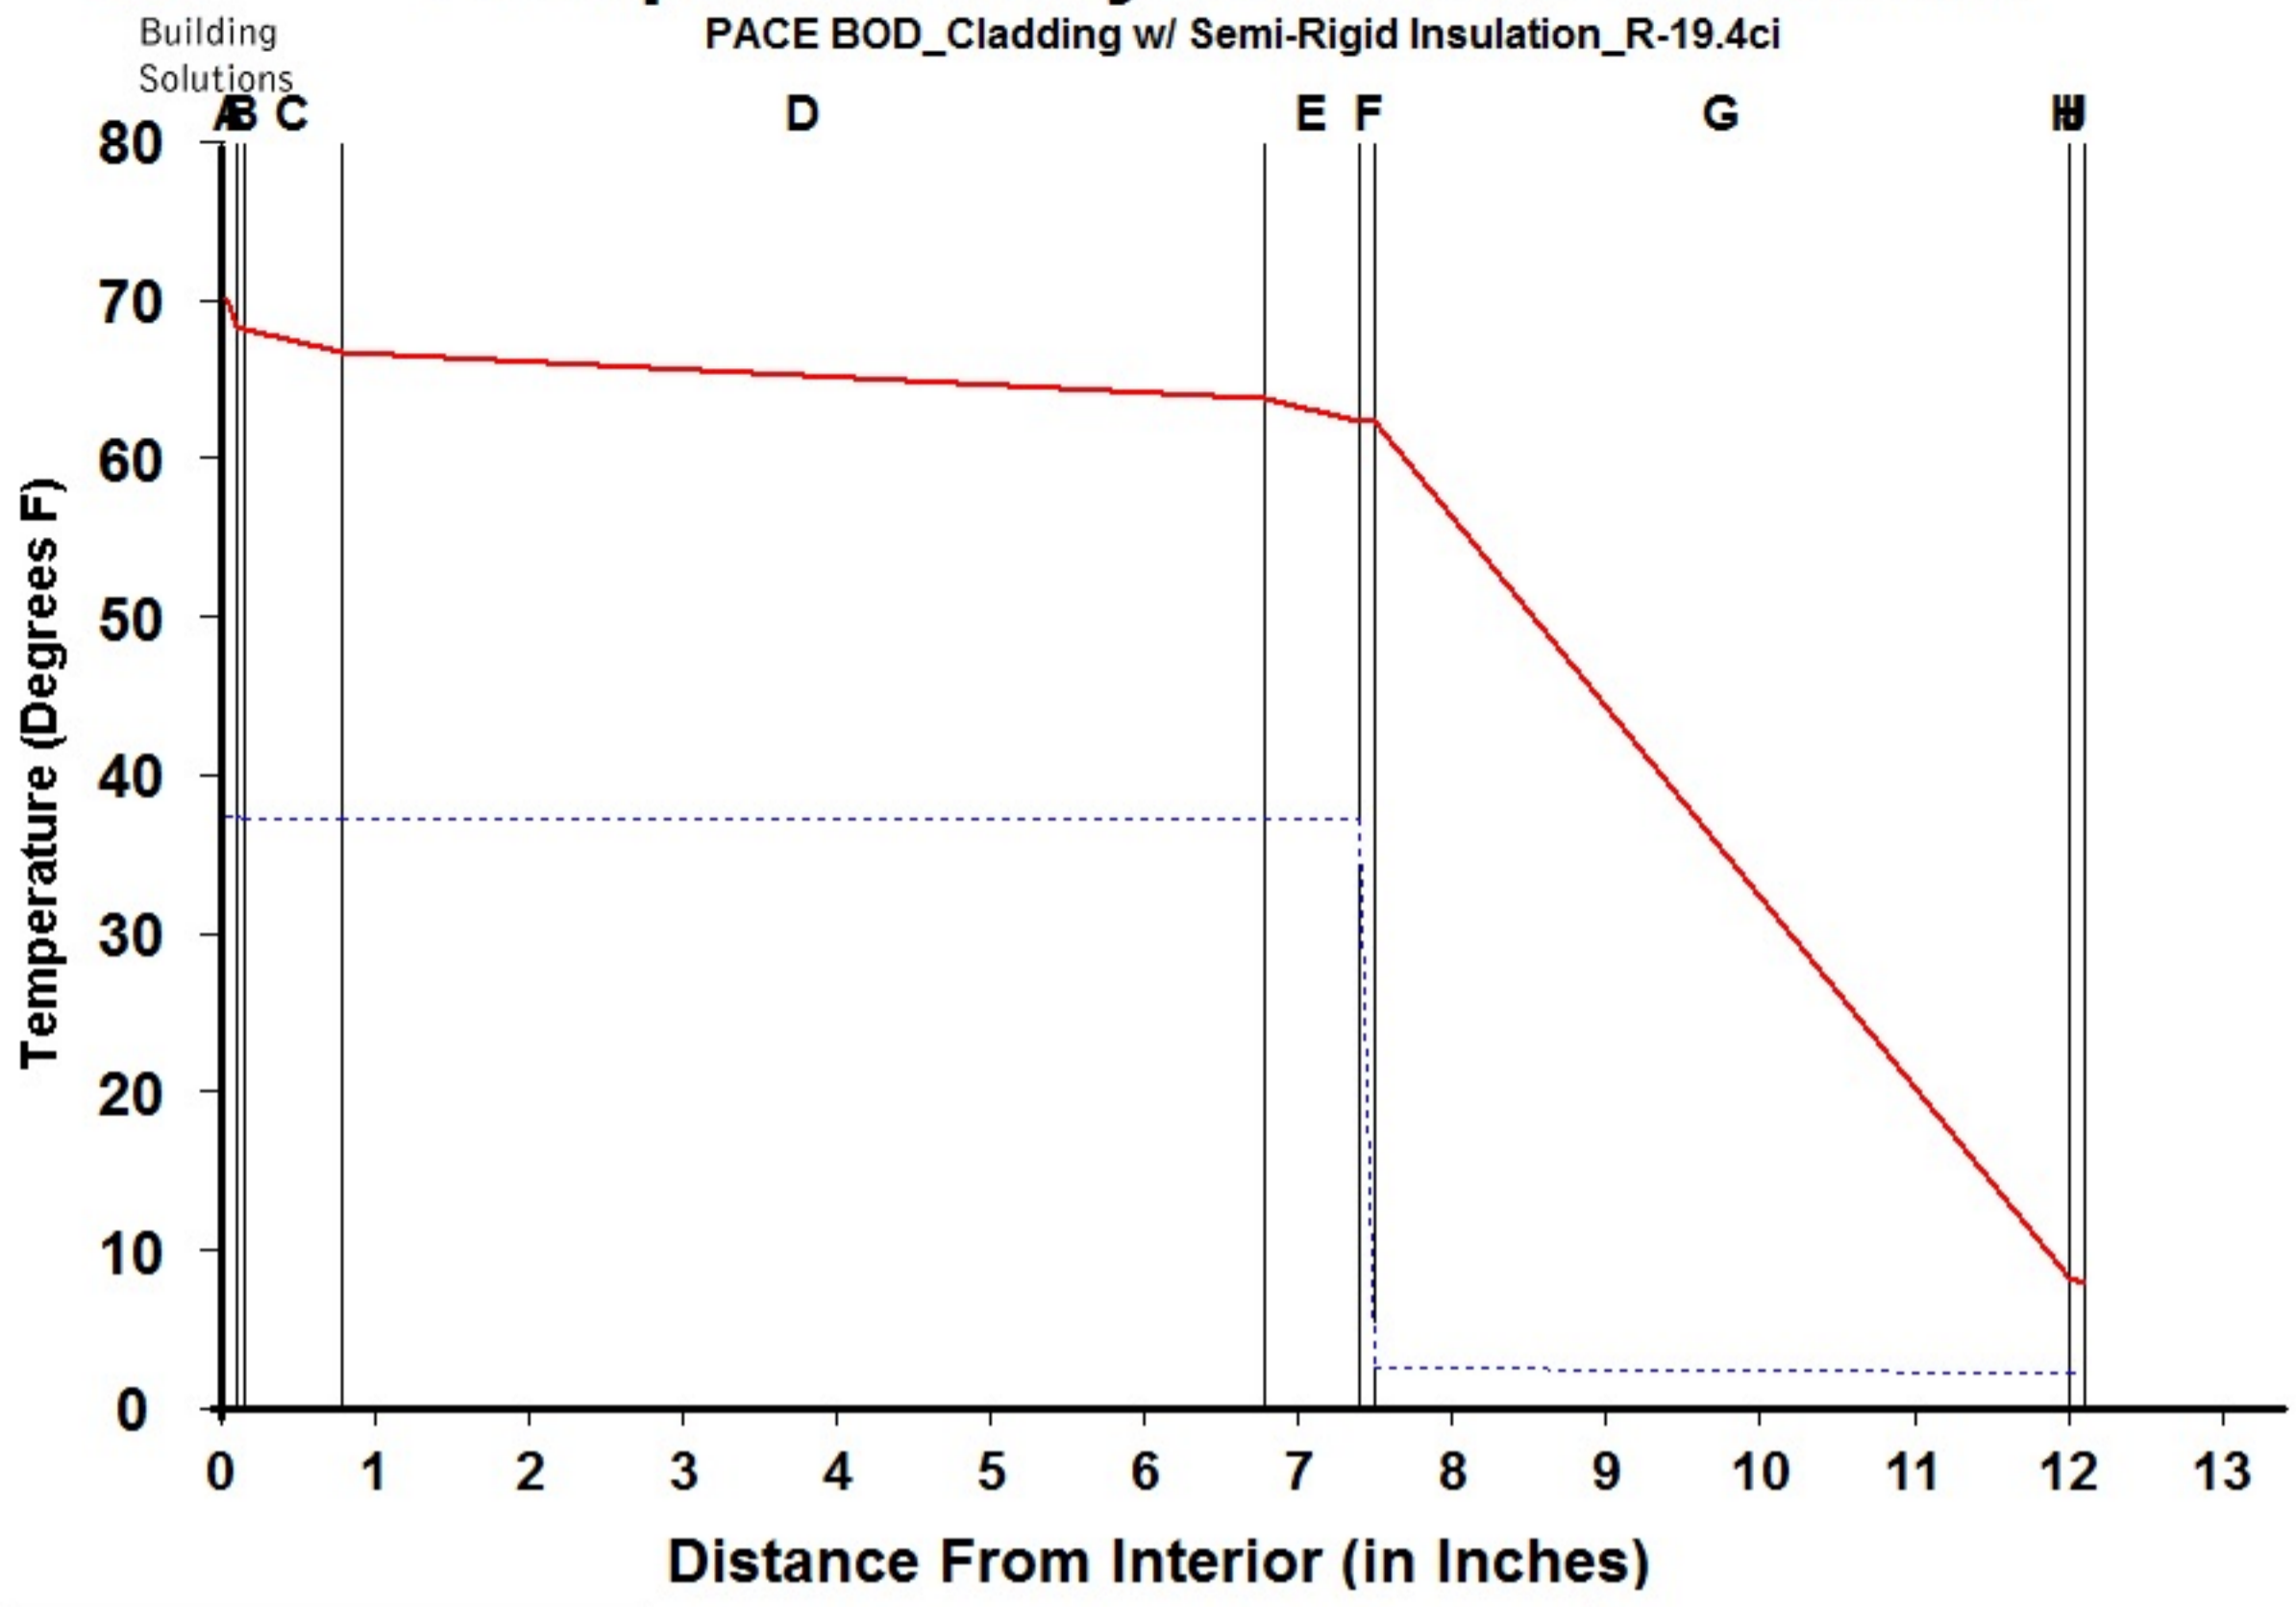

| Legend | |
|---|----------------------|
| — | Actual Temperature |
| - - - - | Dewpoint Temperature |

Dewpoint Theory predicts condensation in a system at any point where the actual and dewpoint temperature lines cross.


| Conditions: | | |
|-------------|----------|----------|
| | Interior | Exterior |
| Temperature | 70.0 | 7.7 |
| Humidity | 30.0 | 75.0 |

| Component Name | Thickness | R-Value | Rep | Interface | Temperature Actual | Temperature Dewpnt | Accum (oz/day-sqft) |
|-----------------------------|---------------|--------------|----------------|-----------|--------------------|--------------------|---------------------|
| A Interior Air Film | 0.100 | 0.68 | 0.001 | -A | 70.00 | 37.17 | 0.000 |
| B Latex Paint 2 Coat | 0.050 | 0.01 | 0.500 | AB | 68.10 | 37.17 | 0.000 |
| C Gypsum Board | 0.625 | 0.56 | 0.023 | BC | 68.08 | 37.06 | 0.000 |
| D Wall Air Space NonRefl | 6.000 | 1.01 | 0.006 | CD | 66.52 | 37.06 | 0.000 |
| E Gypsum Sheathing | 0.625 | 0.56 | 0.027 | DE | 63.70 | 37.06 | 0.000 |
| F CCW 705FRA | 0.100 | 0.01 | 100.000 | EF | 62.14 | 37.05 | 0.000 |
| G Mineral Wool (semi-rigid) | 4.500 | 19.35 | 0.450 | FG | 62.11 | 2.44 | 0.000 |
| H Wall Air Space NonRefl | 0.000 | 0.00 | 0.000 | GH | 8.17 | 2.08 | 0.000 |
| I Ventilated Cladding | 0.000 | 0.00 | 0.000 | HI | 8.17 | 2.08 | 0.000 |
| J Out Air Film Winter | 0.100 | 0.17 | 0.001 | IJ | 8.17 | 2.08 | 0.000 |
| K | | | | JK | 7.70 | 2.08 | 0.000 |
| L | | | | KL | | | |
| TOTAL | 12.100 | 22.35 | 101.008 | L- | | | |



Dewpoint Analysis - Dow Chemical

PACE BOD_Cladding w/ Semi-Rigid Insulation_R-19.4ci + R-13

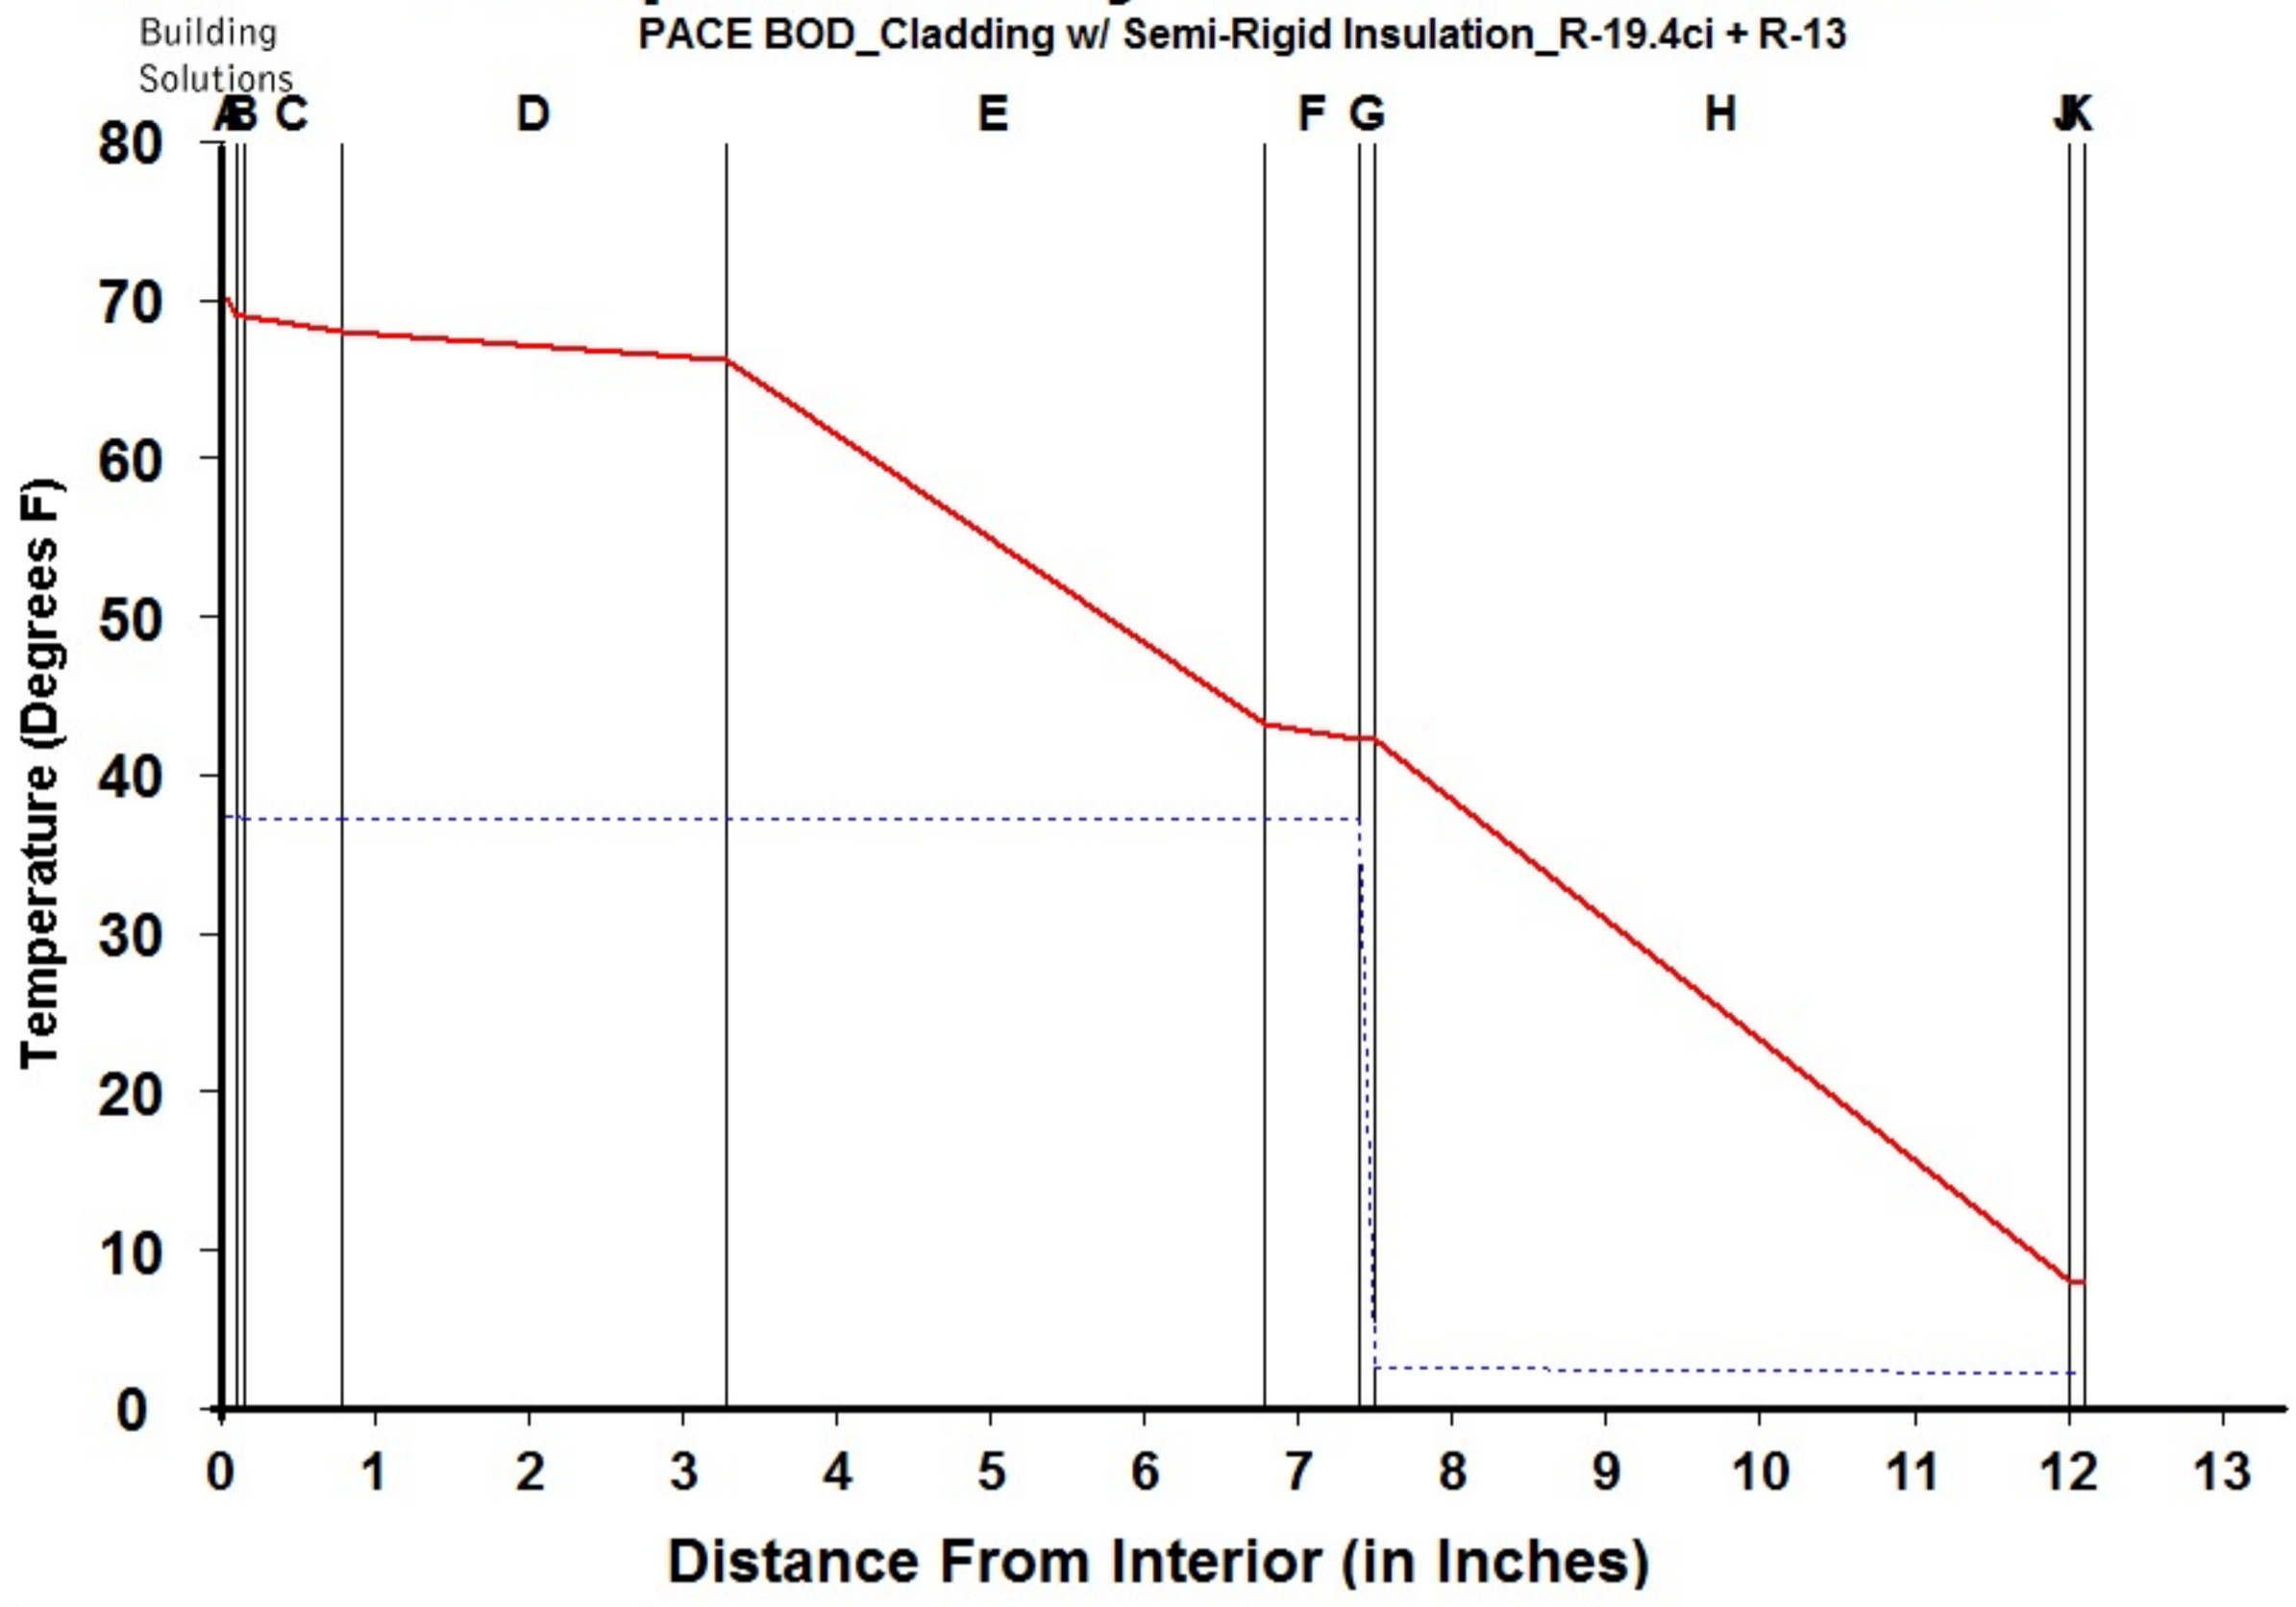

| Legend | |
|---|----------------------|
| — | Actual Temperature |
| - - - - | Dewpoint Temperature |

Dewpoint Theory predicts condensation in a system at any point where the actual and dewpoint temperature lines cross.

| Conditions: | | |
|-------------|----------|----------|
| | Interior | Exterior |
| Temperature | 70.0 | 7.7 |
| Humidity | 30.0 | 75.0 |

| Component Name | Thickness | R-Value | Rep | Interface | Temperature Actual | Temperature Dewpnt | Accum (oz/day-sqft) |
|-----------------------------|---------------|--------------|----------------|-----------|--------------------|--------------------|---------------------|
| A Interior Air Film | 0.100 | 0.68 | 0.001 | -A | 70.00 | 37.17 | 0.000 |
| B Latex Paint 2 Coat | 0.050 | 0.01 | 0.500 | AB | 68.80 | 37.17 | 0.000 |
| C Gypsum Board | 0.625 | 0.56 | 0.023 | BC | 68.78 | 37.06 | 0.000 |
| D Wall Air Space NonRefl | 2.500 | 1.01 | 0.006 | CD | 67.80 | 37.06 | 0.000 |
| E Batt Insulation | 3.500 | 13.00 | 0.010 | DE | 66.02 | 37.06 | 0.000 |
| F Gypsum Sheathing | 0.625 | 0.56 | 0.027 | EF | 43.11 | 37.05 | 0.000 |
| G CCW 705FRA | 0.100 | 0.01 | 100.000 | FG | 42.12 | 37.05 | 0.000 |
| H Mineral Wool (semi-rigid) | 4.500 | 19.35 | 0.450 | GH | 42.10 | 2.44 | 0.000 |
| I Wall Air Space NonRefl | 0.000 | 0.00 | 0.000 | HI | 8.00 | 2.08 | 0.000 |
| J Ventilated Cladding | 0.000 | 0.00 | 0.000 | IJ | 8.00 | 2.08 | 0.000 |
| K Out Air Film Winter | 0.100 | 0.17 | 0.001 | JK | 8.00 | 2.08 | 0.000 |
| L | | | | KL | 7.70 | 2.08 | 0.000 |
| TOTAL | 12.100 | 35.35 | 101.018 | L- | | | |